


Centra Electronic Linear Actuator


MMLYC050-12

BG Инструкции за монтаж – Електрически задвижвани линейни актуатори
CZ Instalační pokyny – Elektrický lineární pohon
DE Installationsanleitung – Elektrischer Linearantrieb
DK Installationsvejledning – Elektrisk betjente lineære aktuatorer
ES Instrucciones de instalación – Actuadores lineales eléctricos
FI Asennusohjeet – Sähkötoimiset lineaariset toimilaitteet
FR Notice d'instalation – Actionneur linéaire électrique
GB Installer Instruction – Electrically operated linear actuators
GR Οδηγίες εγκατάστασης – Ηλεκτρικός γραμμικός κινητήρας
HU Telepítési utasítás – Elektromosan működtetett lineáris működtetők
IT Istruzioni di installazione – Attuatori Elettrici lineari
LT Instaliavimo instrukcija – Elektra valdomi linijiniai pavaros
NL Installateurinstructie – Elektrisch aangedreven lineaire actuatoren
NO Installasjonsveiledning – Elektrisk drevne lineære aktuatorer
PL Instrukcja instalatora – Elektrycznie sterowane siłowniki liniowe
PT Instruções de instalação – Atuadores lineares operados eletricamente
RO Instrucțiuni de instalare – Servomotoare liniare acționate electric
SK Inštalačné pokyny – Electricky riadené lineárne pohony
SV Installationsanvisning – Elektriska linjära ställdon
TR Kurulum Talimatı – Elektrikle çalışan lineer aktüatörler
UA Інструкції з монтажу – Електрично керовані лінійні приводи

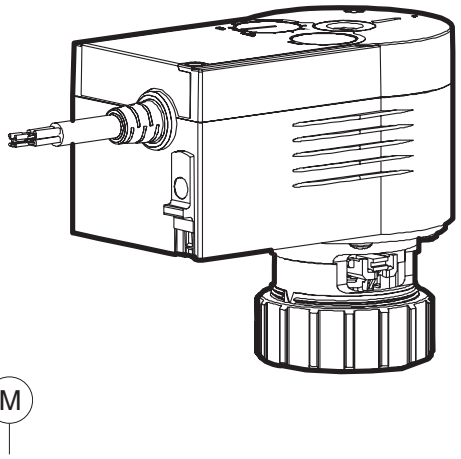


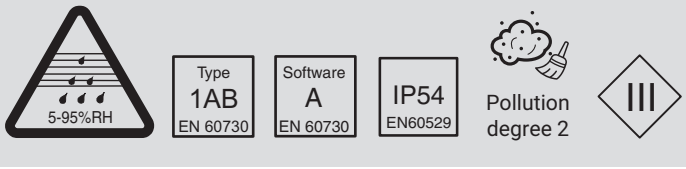

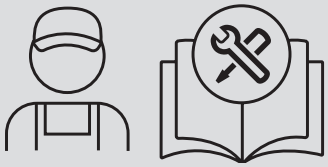


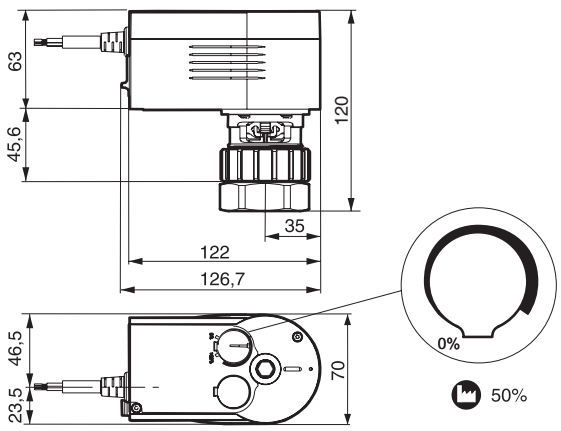

1

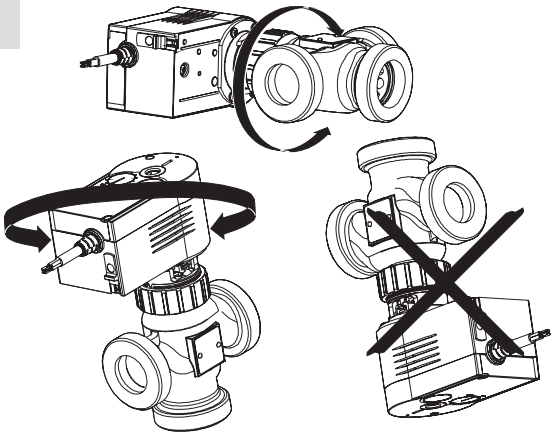


2

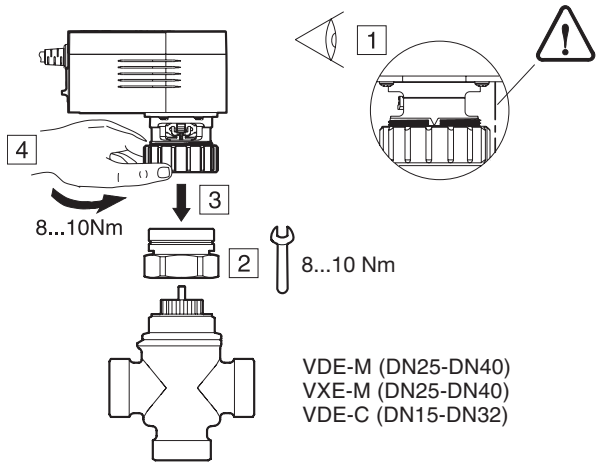

BG не изолирайте
CZ Neizolujte
DE Darf nicht isoliert werden
DK Isoler ikke
ES No debe ser aislado
FI Do not insulate
FR Ne pas isoler
GB Do not insulate
GR Μην μονώνετε
HU Ne szigetelje
IT Non deve venire isolato
LT Neizoliuokite
NL Mag niet worden geïsoleerd
NO Ikke isoler
PL Nie izolować
PT Não isole
RO Nu izolați
SK Neizolujte
SV Får ej isoleras
TR Yalıtım yapmayın
UA Не ізолюйте

3

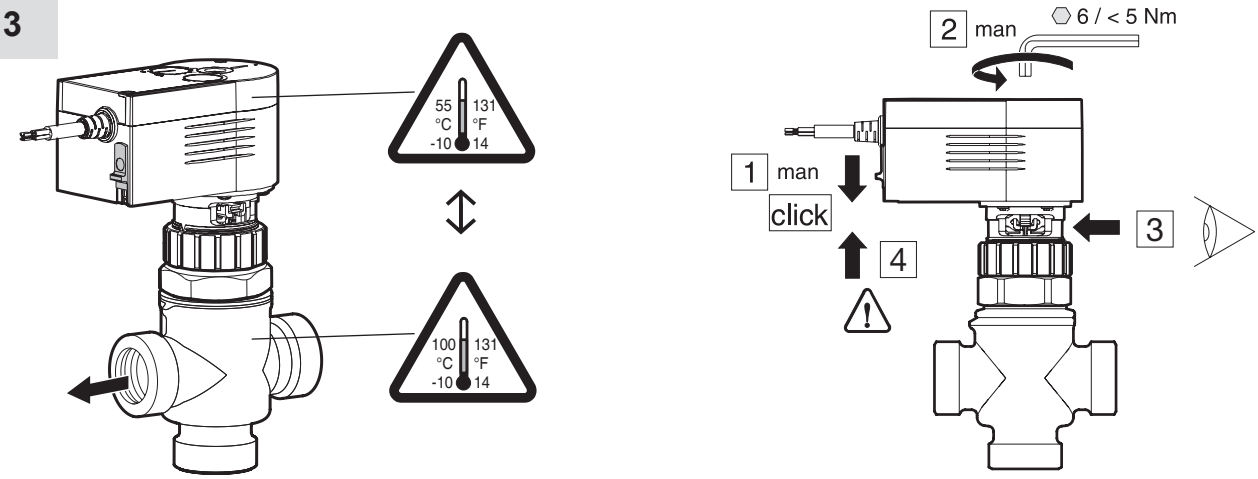



4

Software	Type	
A EN60730	1AB EN60730	IP54 EN60529


BU	BN	BK	RD	GY
blau	braun	schwarz	rot	grau
bleu	brun	noir	rouge	gris
blue	brown	black	red	grey
azzuro	marrone	nero	rosso	grigio
azul	marrón	negro	rojo	gris
blå	brun	svart	röd	grå
blauw	bruin	zwart	rood	grijs

5 x 0,75 mm




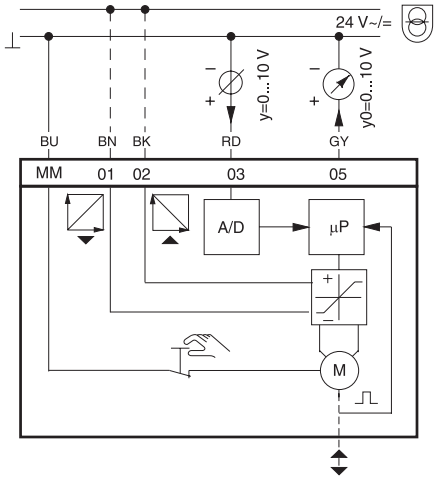


Variante 1 (3pt)

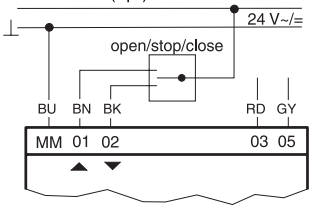


Variante 2 (2pt)

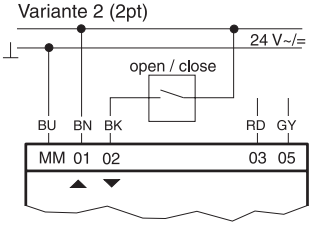


5

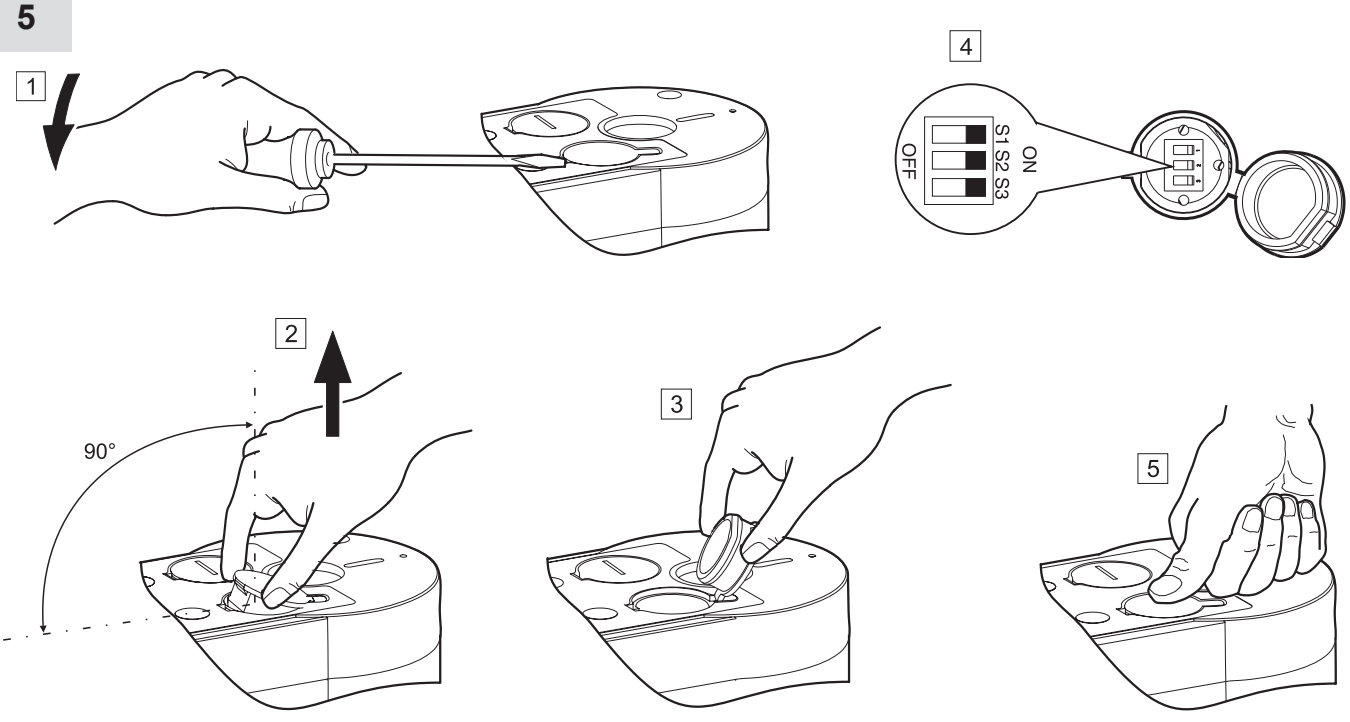

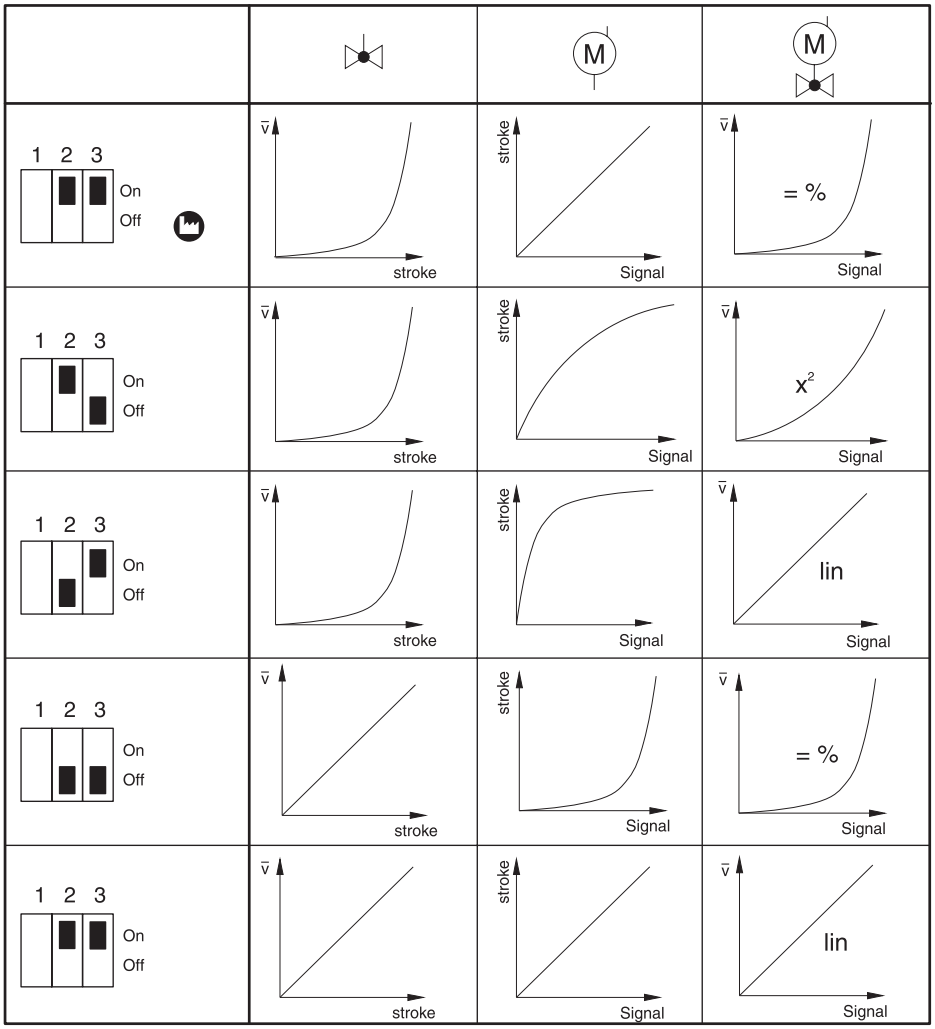


DE	Schalterkodierung	Laufzeit für 8 mm Hub
FR	Codage de commutation	Temps de marche pour une course de 8 mm
EN	Switch coding	Running time for 8 mm of stroke
IT	Codifica di intervento	Tempo di marcia per corsa 8 mm
ES	Codificación de conmutación	Tiempo de funcionamiento para carrera de 8 mm
SV	Kodomkopplare	Gångtid per 8 mm
NL	Schakelodering	Looptijd voor 8 mm slag
1 2 3 On Off		60 ±2 s
1 2 3 On Off		120 ±4 s

BG Инструкции за деинсталиране
CZ Pokyny k demontáži
DE Deinstallationsanweisung
DK Afinstallationsvejledning
ES Instrucción de desinstalación
FI Asennuksen poistaminen
FR Instructions pour de démontage
GB De-installation instructions
GR Οδηγίες αποσυναρμολόγησης
HU Leszerelési utasítások
IT Istruzioni di disinstallazione
LT Išmontavimo instrukcijos
NL Instructie voor het verwijderen
NO Instruksjoner for demontering
PL Instrukcja demontażu
PT Instruções de desinstalação
RO Instrucțiuni de dezinstalare
SK Pokyny na demontáž
SV Isärtagningsinstruktion
TR Demontaj talimatları
UA Інструкції з демонтажу

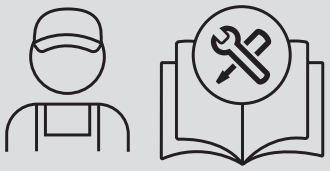

6

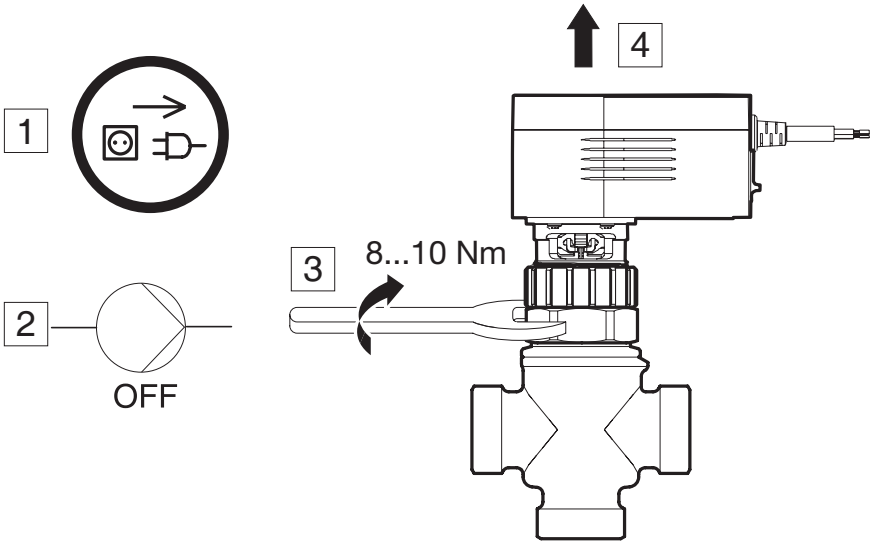

WEEE Directive 2012/19/EU
The product (and contained batteries) should not be disposed of with other household waste. Check for the nearest authorized collection centers or authorized recyclers. The correct disposal of end-of-life equipment will help prevent potential negative consequences for the environment and human health.



PT Embalagens de Papel e Cartão no contenetor azul

resideo

Manufactured for and on behalf of
Pittway Sàrl, Z.A., La Pièce 6,
1180 Rolle, Switzerland

UK authorized representative:
Ademco 1 Ltd,
Newhouse Industrial Estate,
Motherwell, ML1 5SB, UK

US / Canada authorized representative:
Resideo LLC
251 Little Falls dr
Wilmington, DE 19808-1674, US

For more information
resideo.com

Subject to change without notice. R32354545 Rev.A

© 2026 Resideo Technologies, Inc. All rights reserved.